


THIS DRAWING IS INTENDED ONLY AS A GUIDE AND NOT AS A REPLACEMENT FOR PROFESSIONALLY ENGINEERED PROJECT DRAWINGS THIS CONCEPT SYSTEM DRAWING DOES NOT IMPLY COMPLIANCE WITH LOCAL BUILDING CODES. ACTUAL INSTALLATION MAY VARY DEPENDING ON INSTALLATION LOCATION AND PARAMETERS AND IT MUST BE DONE IN ACCORDANCE TO ALL LOCAL BUILDING CODES. VERIFY WITH LOCAL BUILDINGS OFFICIALS BEFORE COMMENCEMENT OF SYSTEM INSTALLATION.

- (A) TANKLESS CIRCULATOR (BRONZE OR S.S.) SELECT SHALL BE 16 GPM MAX (4 PER TANKLESS) @ 23' TOTAL HEAD (10 PSI) + PIPE, VALVES, FITTING & TANK
- (B) INSTALL CIRCUIT SETTERS TO MAINTAIN FLOW INTO UNITS @ 4 GPM MAXIMUM

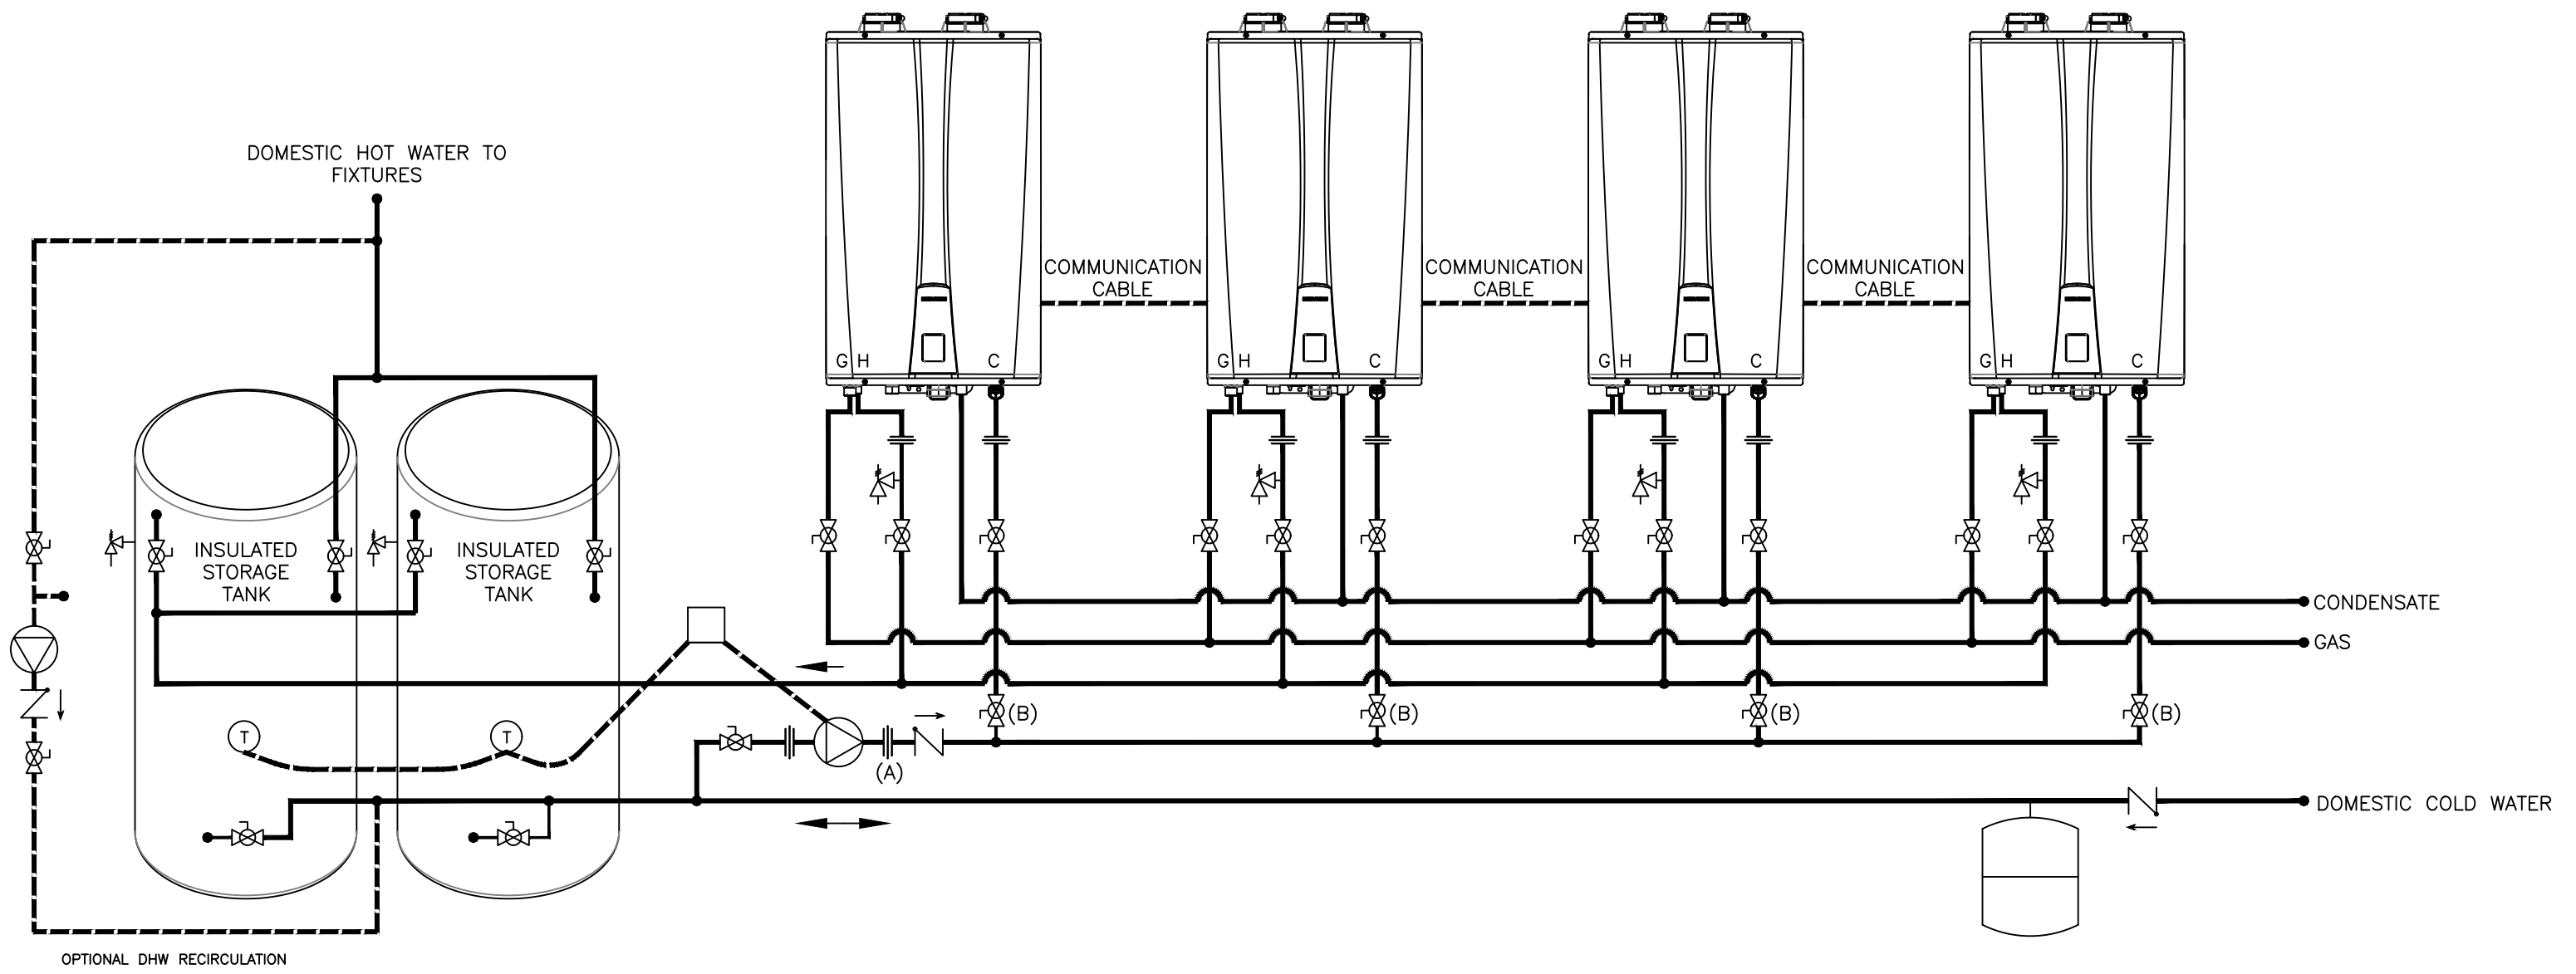

RECOMMENDED PIPE SIZE/HEATER COUNT	1 UNIT - 3/4"	2 UNIT - 1"	3 UNIT - 1-3/4"	4 TO 5 UNITS - 1-1/2"	6 TO 8 UNITS - 2"	9 TO 14 UNITS - 2-1/2"	15 TO 16 UNITS - 3"
------------------------------------	---------------	-------------	-----------------	-----------------------	-------------------	------------------------	---------------------

KD Navien
 20 GOODYEAR
 IRVINE, CA 92618
 800-519-8794
 www.navieninc.com

NPE-S SERIES TANKLESS WATER HEATER

FOUR NPE-S WITH TWO STORAGE TANKS TO MEET FLOW/TEMP RISE REQUIREMENTS

DRAWN BY: J.GARCIA

NPE-S-4-2ST-JG04

MAR 25, 2019

AIR ELIMINATION	CHECK VALVE	FULL-PORT VALVE	AQUASTAT
ZONE VALVE	PRESSURE RELIEF VALVE	CIRCULATOR	BACKFLOW PREVENTOR
DHW CIRCULATOR W/AQUASTAT & CHECK VALVE	MIXING VALVE	EXPANSION TANK	SOLENOID VALVE